

**Consulate of the United States of America  
Fukuoka, Japan**



May 11, 2022

First Set of Questions and Answers

Request for Quotations No. 19JA25-22-Q-0008  
Fuel Tank FRP Lining Project

Question 1:

Is it acceptable to dispose off all fuel in the tank and refill it?  
(In regard to SOW 2.d)

Answer 1:

No. The contractor shall temporarily store the fuel off site and then transfer it back into the tank once the project is complete.

Question 2:

Do we need to apply hi-pressure and sandblast inside the tank or apply hi-pressure or sandblast? (In regard to SOW 4.a)

Answer 2:

We require that the tank interior should be cleaned in accordance with the tank lining application specifications.

Question 3:

Can you provide us with the picture taken during the site survey of the manhole and electric box?


Answer 3:

Manhole and Electrical box below.







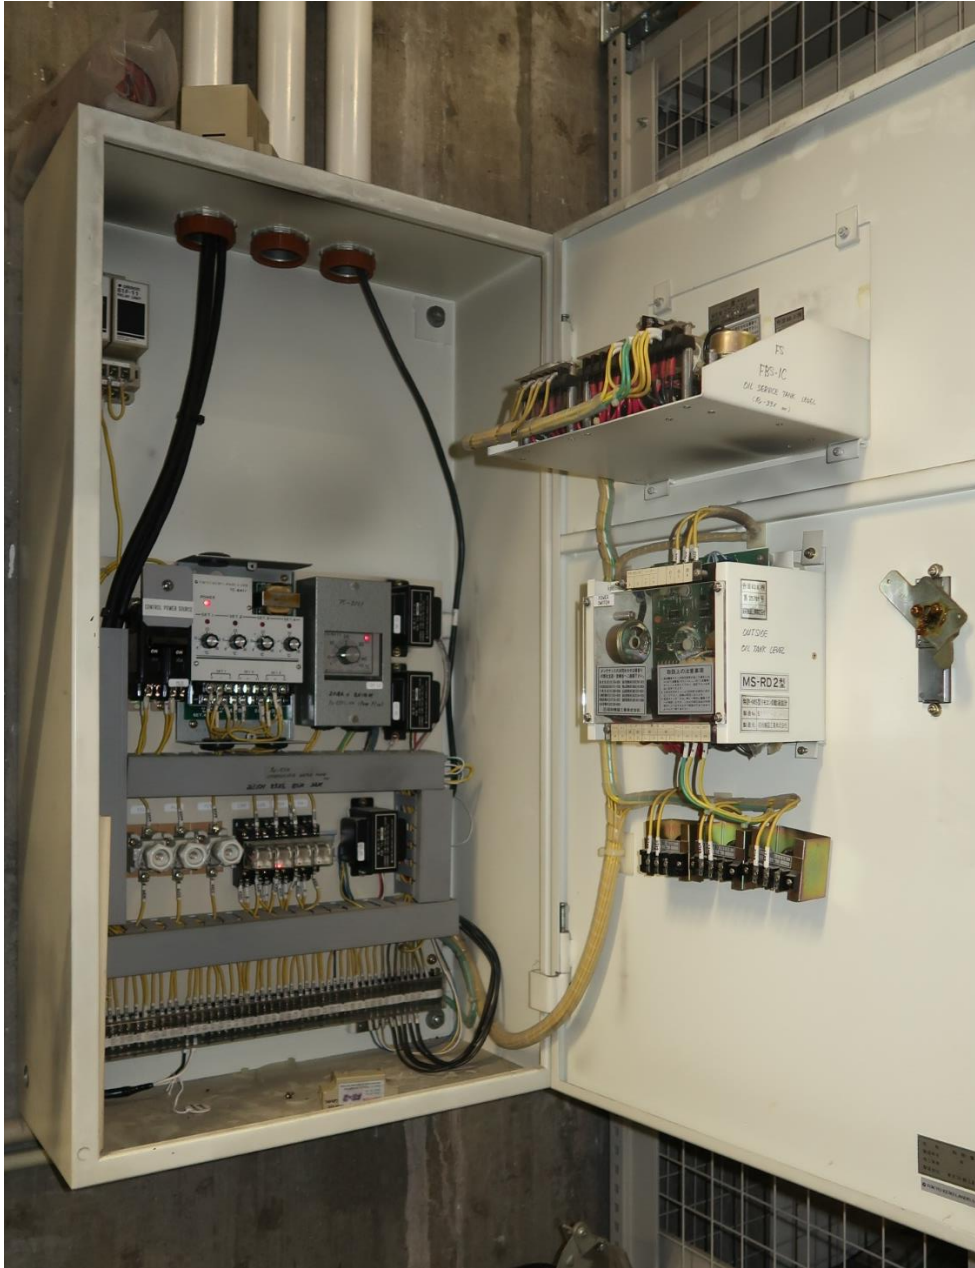





-End of First Set of Questions and Answers-